

**November 15, 2018**  
**BOARD OF COUNTY COMMISSIONERS**  
**ORANGE COUNTY, FLORIDA**  
**Addendum No. 1, IFB Y19-711-RC**  
**PARKS CAMP JOY SEWER & SANITARY FORCE MAIN**

**Bid Opening Date: November 20, 2018**

This addendum is hereby incorporated into the bid documents of the project referenced above. The following items are clarifications, corrections, additions, deletions and/or revisions to, and shall take precedence over, the original documents. Underlining indicates additions, deletions are indicated by ~~strikethrough~~.

**A. The bid opening date remains November 20, 2018 at 2:00 P.M.**

**B. Additions, Revisions, Deletions, Clarifications, Questions and Answers:**

1. **Addition:** Permitting comments from Orange County Development Engineering require use of Orange County's Standard Open Cut Detail. Please see attached, noted as "ATTACHMENT 1,

**C. ACKNOWLEDGEMENT OF ADDENDA**

- a. The Bidder/Proposer shall acknowledge receipt of this addendum by completing the applicable section in the solicitation or by completion of the acknowledgement information on the addendum. Either form of acknowledgement must be completed and returned not later than the date and time for receipt of the bid or proposal.
- b. All other terms and conditions of the IFB remain the same.
- c. **Receipt acknowledged by:**

\_\_\_\_\_  
Authorized Signature

\_\_\_\_\_  
Date Signed


\_\_\_\_\_  
Title

\_\_\_\_\_  
Name of Firm

# Addendum No. 1, IFB Y19-711-RC PARKS CAMP JOY SEWER & SANITARY FORCE MAIN

**NOTE:**

SUB-GRADE CUT TO BE COMPACTED TO 95% MAX. DENSITY AS DETERMINED BY AASHTO T - 180.  
CUT TO BE REPLACED WITH AN EIGHT (8") INCH 3000 PSI HIGH EARLY CONCRETE TO TOP OF EXISTING BASE.  
CUT AREA TO BE PLATED OR PROTECTED ON DAY OF POUR. EXISTING SURFACE TO BE SAW CUT  
TO AN AREA FIVE (5') FEET, BEYOND THE BASE CUT.

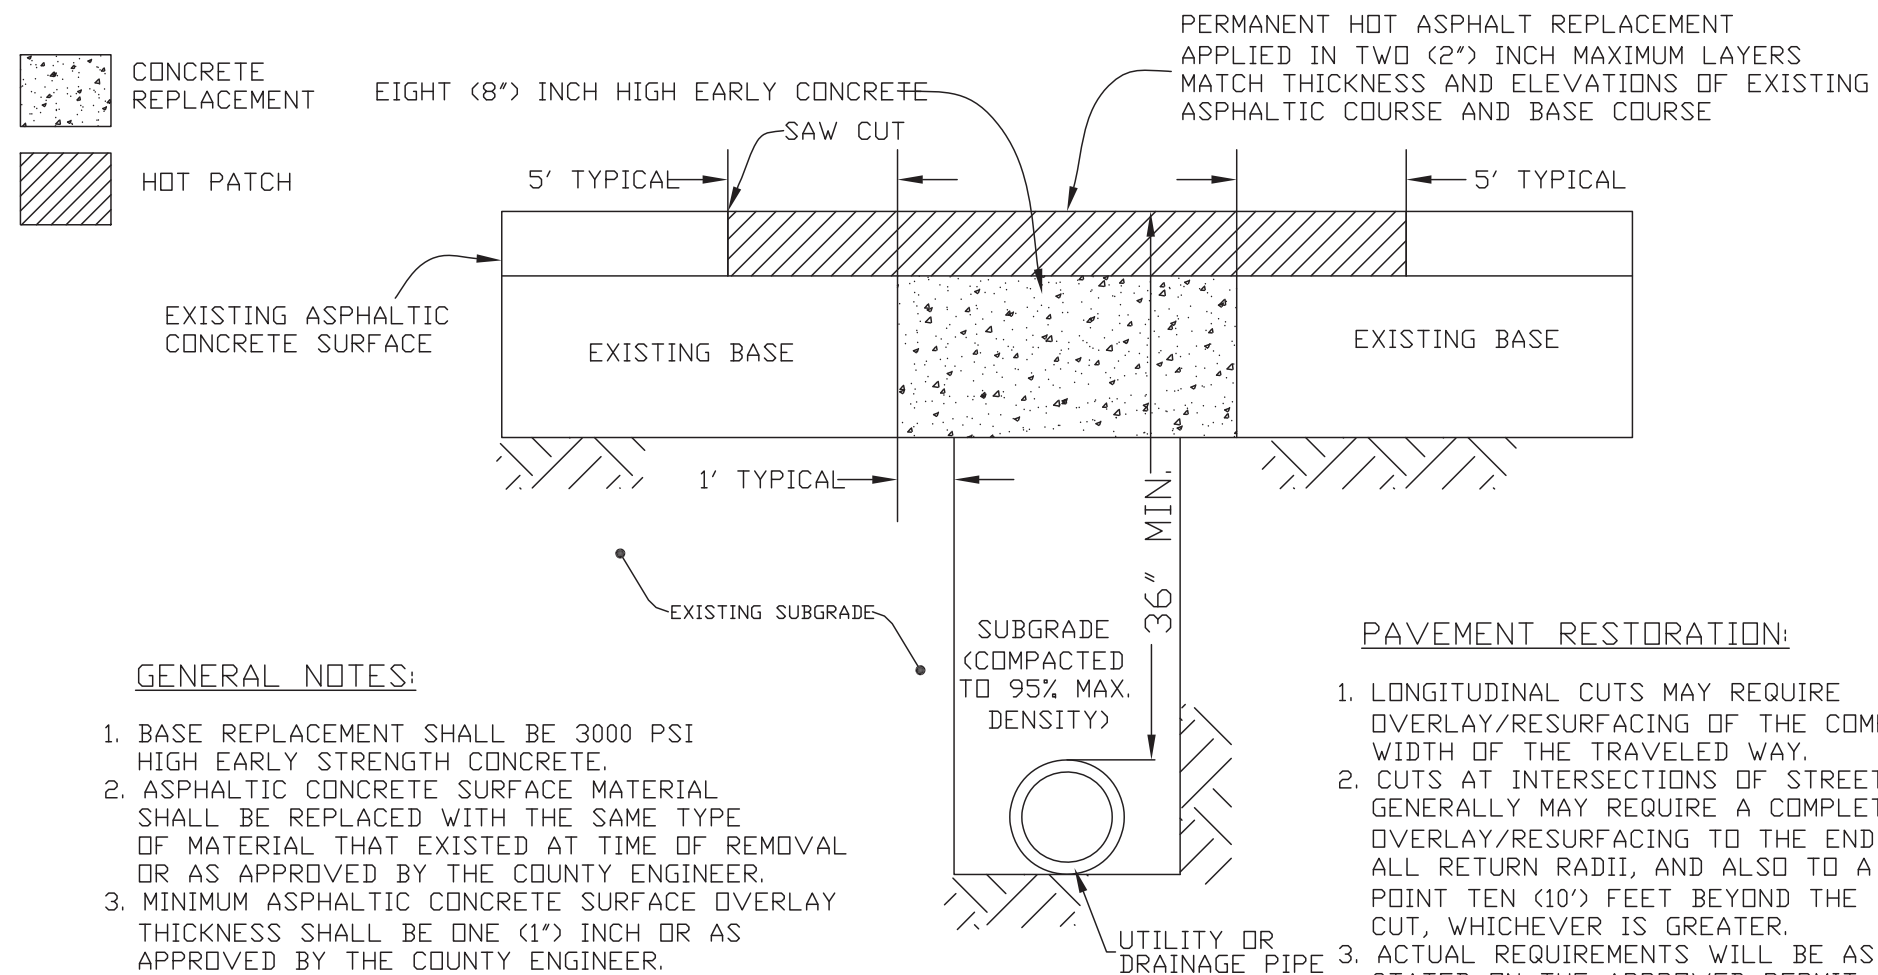

**GENERAL NOTES:**

1. BASE REPLACEMENT SHALL BE 3000 PSI HIGH EARLY STRENGTH CONCRETE.
2. ASPHALTIC CONCRETE SURFACE MATERIAL SHALL BE REPLACED WITH THE SAME TYPE OF MATERIAL THAT EXISTED AT TIME OF REMOVAL OR AS APPROVED BY THE COUNTY ENGINEER.
3. MINIMUM ASPHALTIC CONCRETE SURFACE OVERLAY THICKNESS SHALL BE ONE (1") INCH OR AS APPROVED BY THE COUNTY ENGINEER.
4. ALL JOINT CUTS SHALL BE MECHANICALLY SAW CUT.
5. FLOWABLE FILL MAY BE USED FOR COMPACTED SUBGRADE AND BASE REPLACEMENT WHEN APPROVED BY THE COUNTY ENGINEER.

**PAVEMENT RESTORATION:**

1. LONGITUDINAL CUTS MAY REQUIRE OVERLAY/RESURFACING OF THE COMPLETE WIDTH OF THE TRAVELED WAY.
2. CUTS AT INTERSECTIONS OF STREETS GENERALLY MAY REQUIRE A COMPLETE OVERLAY/RESURFACING TO THE END OF ALL RETURN RADII, AND ALSO TO A POINT TEN (10') FEET BEYOND THE CUT, WHICHEVER IS GREATER.
3. ACTUAL REQUIREMENTS WILL BE AS STATED ON THE APPROVED PERMIT OR AS DIRECTED BY INSPECTION.

## STANDARD ROADWAY OPENCUT CROSS SECTION DETAIL

FINAL RESTORATION - TYPICAL OF MAJOR OPEN CUTS

"ATTACHMENT 1, to ADDENDUM NO. 1"